ELEVATION

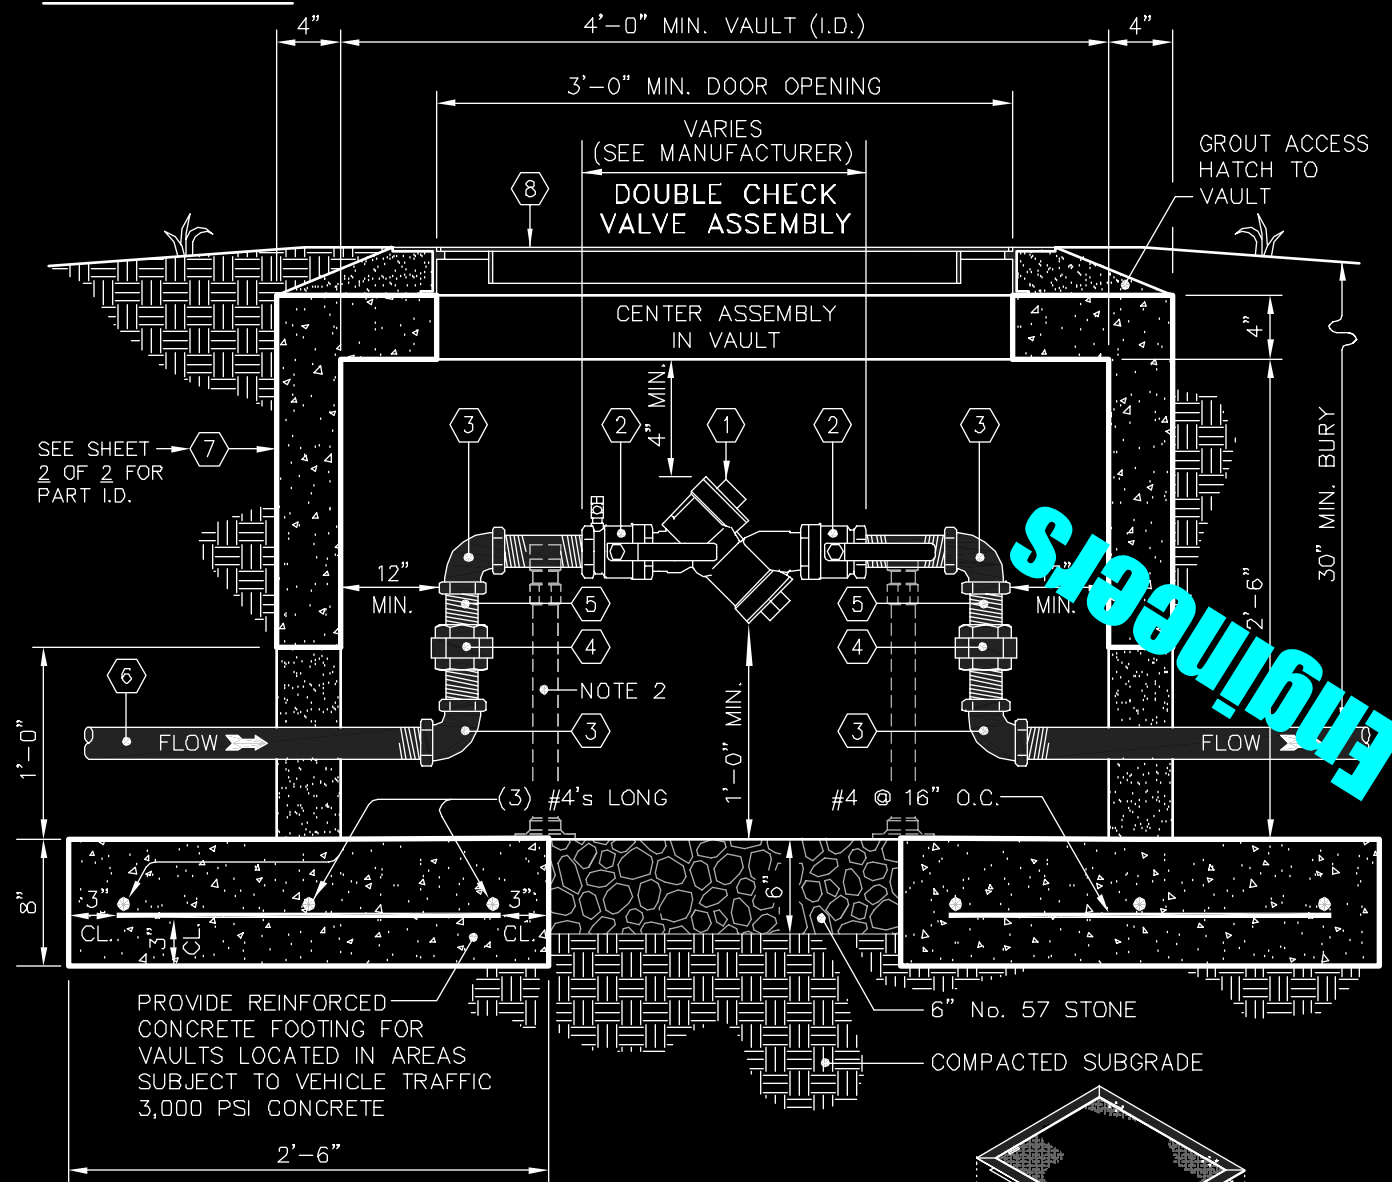

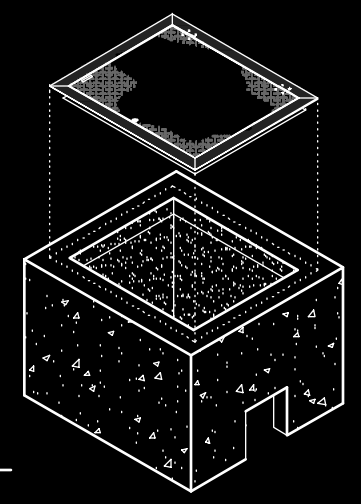

TYPICAL BOX

PLAN VIEW

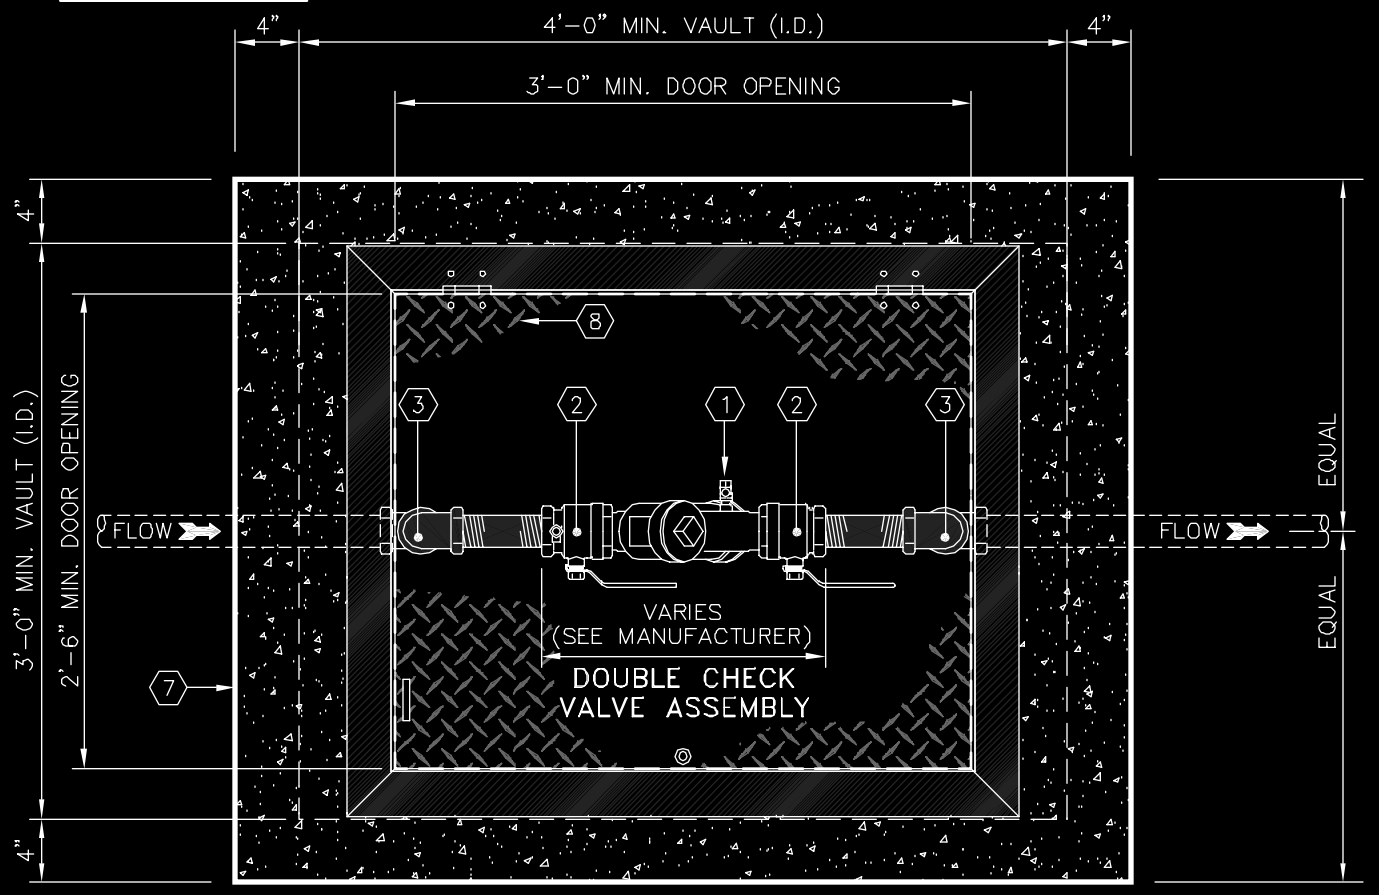

#		MANUFACTURER MODEL / Cat. No.
1	DOUBLE CHECK VALVE ASSEMBLY	---
2	1/4 [illegible] PORT BRONZE BALL SHUT–OFF VALVE	MILLER SUPPLY Co. / DC–590
3	90° BRA[illegible]	---
4	THREADED U[illegible]	---
5	3/4" THRU 2 1/2" STAINLESS STEEL OR BRASS THREADED PIPE	---
6	3/4" THRU 2 1/2" STAINLESS STEEL OR BRASS THREADED PIPE	---
7	PRECAST CONCRETE METER VAULT VERIFY FITTINGS WILL FIT INSIDE BOX BEFORE ORDERING	STAY–RIGHT 3'x4' (OR APPROVED EQUIVALENT)
8	ACCESS HATCH – (LID TO HAVE "SLAM LOCK") NO EXPOSED HINGES OR LOCKS – H20 LOADING FOR VAULTS LOCATED IN PAVEMENT. OTHERWISE, PEDESTRIAN RATED (300PSF) VERIFY FITTINGS WILL FIT THRU OPENING BEFORE ORDERING	HALLIDAY PRODUCTS / S1R3036 (OR APPROVED EQUIVALENT)

NOTES:

1. Ensure positive surface grade away from vault.
2. Provide pipe stands for 1 1/2" and 2" DCV assembly.

Approved Engineering Consulting Plans

3/4" to 2" DCV ASSEMBLY
(UNDER GROUND VAULT)

3/4" to 2" DCV ASSEMBLY
(UNDER GROUND VAULT)